

GRADATION ANALYSIS TEST REPORT

for Product: 10/20/

Supplier/ source: Dagenham

Material type: Drystone aggregate Test method: Wash grading to BS EN 932-1: 1997

SAMPLE INFORMATION

Sampled/ tested
Thu 05 May 2022/ 16-05-22
at 0000 hrs

Sample number GDAT_13041_01BD

Location	-	Chainage/layer	-
Ticket/truck number	-	Weather conditions	-
Sampling notes	-	Aggregate type	-
Remarks 1	-	Remarks 2	-

SAMPLE ANALYSIS


Sieve size	Percent passing	Specification limits	Complies ?
40mm	100	100 - 100	yes
31.5mm	100	98 - 100	yes
20mm	87	85 - 100	yes
16mm	53	-	-
14mm	35	-	-
10mm	4	0 - 20	yes
4mm	1	0 - 5	yes
63µm	0.1	0.0 - 3.0	yes
Moisture content %	2.0	not specified	-
Flakiness index	no result	<=35	-

Parameters are evaluated to the accuracy of spec. limits

REMARKS

Compliance status ok
Category A of A-C includes secondary parameters

.....
.....
.....
.....
.....
.....
.....
.....

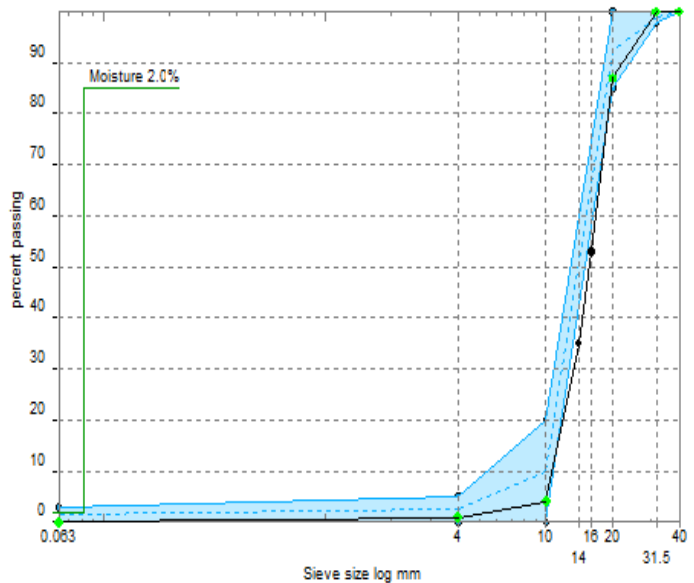

Signed _____

Print date 24 May 2022