

GRADATION ANALYSIS TEST REPORT

for Product: 0/4/ 0/4 MP Washed Sand

Supplier/ source: Dagenham

Material type: Drystone aggregate Test method: Wash grading to BS EN 932-1: 1997

SAMPLE INFORMATION

Sampled/ tested
Thu 05 May 2022/ 16-05-22
at 0000 hrs

Sample number **GDAT_13036_01BD**

Location - Chainage/layer -
Ticket/truck number - Weather conditions -
Sampling notes - Aggregate type -
Remarks 1 - Remarks 2 -


SAMPLE ANALYSIS

Sieve size	Percent passing	Specification limits	Complies ?
8mm	100	100 - 100	yes
6.3mm	100	95 - 100	yes
5mm	100	-	-
4mm	98	85 - 100	yes
2.8mm	95	-	-
2mm	90	-	-
1mm	80	60 - 100	yes
500µm	67	30 - 70	yes
250µm	33	0 - 40	yes
125µm	8	-	-
63µm	2.3	0.0 - 3.0	yes
Moisture content %	4.5	not specified	-
Chloride content %	0.003	<=35.000	yes

Parameters are evaluated to the accuracy of spec. limits

REMARKS

Compliance status ok
Category A of A-C includes secondary parameters

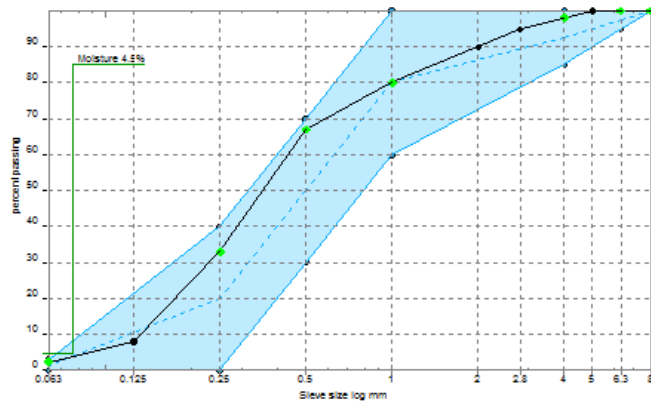

Signed _____

Print date 24 May 2022